



Red Valve Company, Inc.®

SERIES 9000 PINCH VALVE

CYLINDER OPERATED

Installation, Operation, and Maintenance Manual



The Red Valve Series 9000 hydraulically actuated Pinch Valve is a bi-directional valve designed for tough slurry applications. The elastomer sleeve closes on entrapped solids in the line. The flexing action of the sleeve breaks up any sediment or build-up in the valve, which makes the Series 9000 a reliable, low maintenance valve.

A variety of elastomers are available to suit your specific needs. Along with the standard Red Valve sleeve, we offer Double Wall, Cone, and Variable Orifice Sleeves for special applications.

Series 9000 valves are constructed with 300# or 600# ANSI flanges.

- Simple design
- No Packing to maintain, ever
- Cost effective
- No cavities or dead spots to bind valve operation
- Low maintenance

IMPORTANT

Please take a moment to **review this manual. Before performing any maintenance on the valve be sure that the pipeline has been depressurized.** The improper installation or use of this product may result in personal injury, product failure, or reduced product life. Red Valve Co., Inc. can accept NO liability resulting from the improper use or installation of this product. If you have any questions or problems, please call the customer service hotline at (412) 279-0044. We appreciate your comments. And thank you for choosing Red Valve.

GENERAL DESCRIPTION

The Red Valve Series 9000 High Pressure Pinch Valve consists of four major components:

1. **Body** The body acts as a housing and support for the other valve components. It is not the primary pressure containing component.
2. **Sleeve** The sleeve is the primary pressure containing component and is the only component in contact with the process fluid.
3. **Mechanism** The pinching mechanism consists of a top and a bottom pinch bar with supports and carriers. The top pinch bar is connected to a pinch bar carrier connected to a stem.
4. **Hydraulic Actuator** The actuator relies on hydraulic pressure within the cylinder to move a piston up or down. The stem is connected to the piston rod.

INSTALLATION

1. Series 9000 have standard ANSI B16.5 Class 300 or ANSI B 16.1 Class 250 flanges. Due to clearances, the valves have tapped holes instead of through holes. **CAUTION:** Do not use bolts that are too long, as they will bottom out and crack the body. Stud bolts are recommended.
2. The flanges mating to the Series 9000 should be serrated approximately $1/16"$ x 90° . Rubber will creep along smooth metal, PVC, or Teflon® flanges, eventually causing a leak. Flange I.D. should match the sleeve I.D. and should be free of sharp edges which could cut into sleeve flanges. Weld neck or socket weld flanges are recommended. Slip on or screw on flanges have a larger I.D. and can cut the rubber sleeve. If slip on or screw on flanges must be used, grind off all sharp I.D. edges.
3. Do not use sharp tools, such as screwdrivers or crow bars, on the rubber during installation. This can cut and damage the flange face and cause possible leakage.
4. The valve should be completely open before installing the valve in the pipeline or tightening the flange bolts. Tighten all flange bolts to values listed in the table on the back page. You will not overtorque the flange rubber.

OPERATION AND ADJUSTMENT


The most critical factor for successful operation of the Series 9000 is using the correct amount of hydraulic pressure to operate the valve.

The amount of pressure required to close the valve depends on the pressure in the pipeline. Most cylinder operated valves require the full rated hydraulic pressure to open or close the valve. Operating the valve with less pressure may shorten the sleeve life, since velocities in a cracked open position are severe. If the valve is of a fail close design, insufficient hydraulic pressure may not allow the valve to fully open.

1. If flanges leak during operation, open the valve and retighten the flange bolts. Stroke the valve closed and then reopen and retighten the flange bolts. Do not clean the body end flange surfaces with rough abrasive wheels, as this will gouge the sealing surface and flange leakage will result.
2. If the valve leaks after installation, the leakage can be stopped by turning lower pinch bar adjusting bolts (14) three or four clockwise revolutions. **Note: Loosen jam nuts before adjusting, and re-tighten after adjusting. Be sure to adjust each bolt an equal amount.**
3. A spare sleeve and spare body gaskets should be placed on order when this valve is put in service.

PARTS – Series 9000

- | | |
|----------------------------|--------------------------------------|
| 1. Actuator | 8. Upper Pinch Bar |
| 2. Mounting Plate | 9. Lower Pinch Bar |
| 3. Gasket | 10. Lower Pinch Bar Support |
| 4. Body Bolts | 11. Body Gaskets |
| 5. Body Top Half | 12. Body Nuts |
| 6. Sleeve | 13. Body Bottom |
| 7. Upper Pinch Bar Carrier | 14. Lower Pinch Bar Adjustment Bolts |

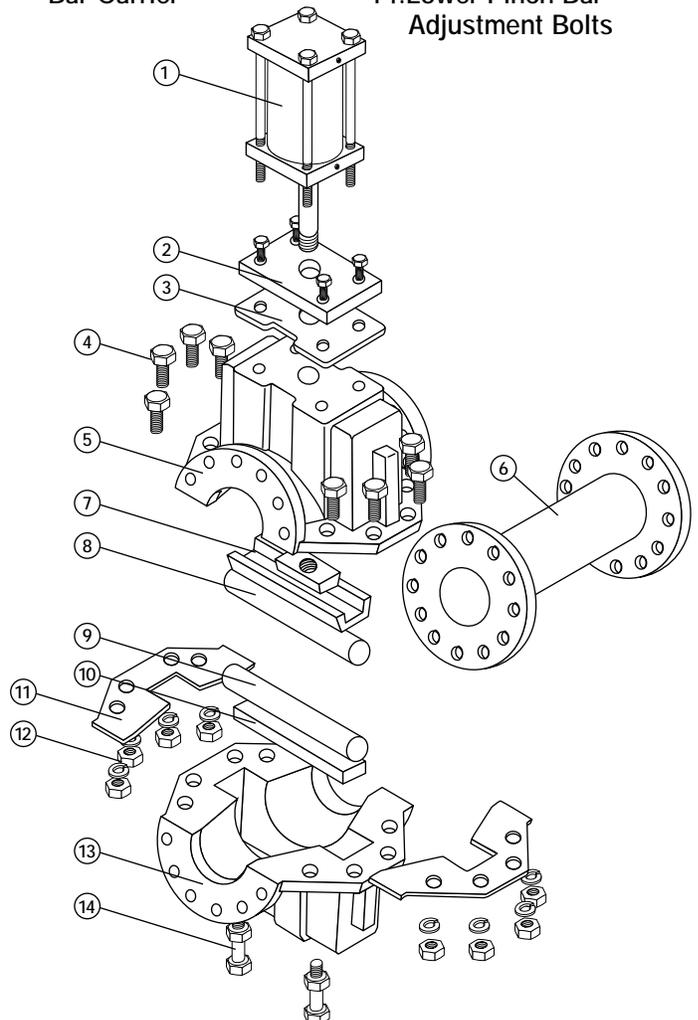

MAINTENANCE

1. **Inspection** The valve should occasionally be inspected for damage and wear. The inspection period should be determined by the severity of the service and environment. If the valve is periodically inspected and preventive maintenance done, the valve will last longer and operate better.

Caution: Do not remove any valve parts or bolting with pressure in the line. It is easy to inspect the valve for obvious problems.

2. **Sleeve Replacement** **WARNING:** Be sure to flush all hazardous material and bleed all pressure from the pipeline before proceeding!

1. Open the valve completely – operate the cylinder to retract the piston rod.
2. Remove the valve from the pipeline.
3. Disassemble the body by removing the body bolts and remove the lower half of the body.
4. Remove the old sleeve by bending the flanges, and pulling the sleeve from the body casting. Remove the side body gaskets.
5. Place the new sleeve in the bottom casting and line up bolt holes. Be sure the flange bolt holes in the sleeve line up with the bolt holes in the body flange before bolting the two halves together. **Note:** For Cone and Variable Orifice Sleeves, be sure that the sleeve is oriented correctly with the flange marked "Inlet" on the upstream side of the valve, to insure proper operation of the valve. Place new side body gaskets. **Do not reuse old side gaskets, as they have already been compressed and will not regain their original shape sufficiently to seal the body halves.** Place top body components and install body bolts.

Should it be necessary to adjust the upper pinch bar, this can be accomplished by removing the actuator mounting bolts and rotating the piston assembly counter-clockwise to extend the upper pinch bar or clockwise to retract the upper pinch bar. Re-install actuator mounting bolts.

STORAGE

If your Series 9000 Pinch Valve is to be stored for a period of time prior to installation, the following guidelines will help preserve the valve and assure trouble-free installation.

1. Store valve and spare sleeves in a cool, clean, dry location.
2. Avoid exposure to light, electric motors, dirt, or chemicals. Resilient sleeves are subject to rapid deterioration when exposed to ozones and certain chemicals.
3. Grease flange threads liberally to inhibit rust or corrosion. Store valve in the full open position. Do not stack other items on top of the valve.
4. Store Installation Operation and Maintenance Manual with the valve so it will be readily available for installation.

DOUBLE WALL SLEEVES

Double Wall Sleeves have triple life expectancy on severe abrasion. The extra thickness requires the next larger flange size on the valve body.

It is recommended that the sleeve I.D. be the same as the pipe I.D. (Fig. 1) This will require that a reducing flange be purchased, or an oversize mating flange be installed on the pipe. This is easily done by using blind flanges and boring the I.D. to suit the existing pipe. For example, on a 6" flange, 4" bore Double Wall valve, the mating flange would be a 6" blind flange bored out to slip over the 4" pipe (approximately 4-1/2" dia.).

If it is not possible to match the pipe and sleeve I.D. as described above, the flanges will mate and the sleeve I.D. will protrude into the pipeline (Fig. 2). To prevent bulging and premature breaking of the Double Wall Sleeve, a steel washer must be installed as shown (Fig. 3). The steel washer should be 1/8" thick and be serrated on the side facing the sleeve. The washer

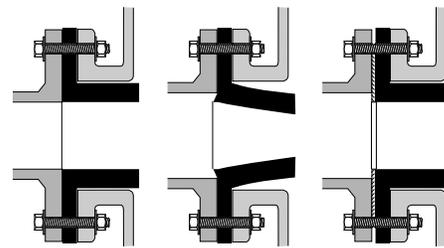


Fig. 1

Fig. 2

Fig. 3

O.D. can be just short of the bolt holes, or it can equal the flange O.D. and bolt holes can be drilled through the washer.

WASHER SIZING FOR SERIES 9000 VALVES

VALVE FLANGE SIZE	PORT SIZE	MINIMUM WASHER THICKNESS
1"	1/2"	1/4"
2"	1"	1/2"
3"	2"	1/2"
4"	3"	1/2"
6"	4"	1"
8"	6"	1"
10"	8"	1"
12"	10"	2"


MISCELLANEOUS

Returns All returns must have standard Red Valve Company return goods tags. Sleeves to be inspected by Red Valve Company must have the tag firmly attached to the sleeve via the bolt holes, and must list the company, order number, address, valve serial number, your telephone number, operating temperature, pressure, closing frequency, fluid media, and total days in service.


Important: If the product being returned has been in contact with a hazardous chemical or material, an MSDS (Material Safety Data Sheet) must be provided with the return paperwork; otherwise, the return will not be processed.

SERIES 9000 FLANGE BOLTING SPECIFICATIONS


VALVE SIZE	NO. OF BOLTS	BOLT CIRCLE DIAMETER	THREAD SIZE	A	B	BOLT TORQUE (ft. lbs)	
						300 psi	720 psi
1"	4	3-1/2"	5/8" - 11 NC	3/4"	1"	55	130
2"	8	5"	5/8" - 11 NC	3/4"	1"	45	110
3"	8	6-5/8"	3/4" - 10 NC	1"	1-1/4"	85	205
4"	8	7-7/8"	3/4" - 10 NC	1"	1-3/8"	130	310
6"	12	10-5/8"	3/4" - 10 NC	1"	1-7/16"	115	270
8"	12	13"	7/8" - 9 NC	1"	1-5/8"	170	410
10"	16	15-1/4"	1" - 8 NC	1-1/4"	1-13/16"	180	430
12"	16	17-3/4"	1-1/8" - 7 NC	1-1/4"	2"	290	700

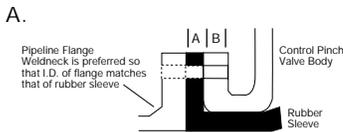


A. Standard pinch valves are built to schedule 40 pipe I.D. and to ANSI Class 125/150# flange and bolt circle specifications. It is recommended that the mating flanges are flat and full faced.

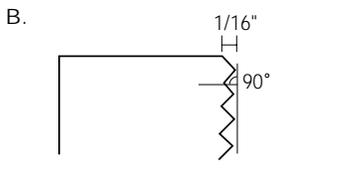


B. It is recommended that the mating flange be serrated to "grip" the rubber flange. The serrations should be cut 1/16" deep, with a 90 degree tool point. The pitch should be 8 (eight) cuts per inch.

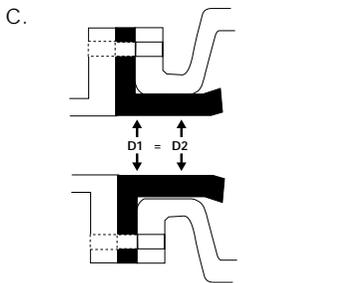


C. Mating flange ID must match the pinch valve sleeve ID.

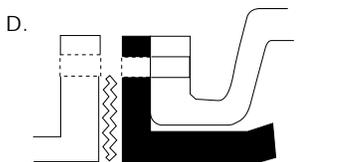

D. When installing a pinch valve to a rubber, PVC, or any "slick" mating flange, we recommend that you install a metal serrated gasket between the two flanges to assist in the seal.

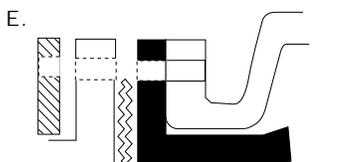

E. When bolting a pinch valve to a PVC or synthetic mating flange, use a split back-up retaining ring, since the mating flange will yield prior to generating enough force on the flange faces for a proper seal.

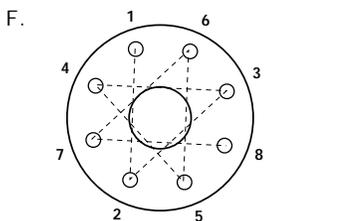

F. Torque all the flange bolts in a star pattern, first to 50% of tabulated valves, then retorquer to 100% of tabulated valves. If greater torque is required, continue retorquing in increments of 50% of tabulated valves. Use of high quality anti-seize compound on all bolt threads is recommended.

Variables such as the surface finish on bolt threads, type of anti-seize compound used, and surface finish of the mating flanges all have an effect on the minimum torque required to obtain a leak-tight flange seal.

MAXIMUM HYDRAULIC CYLINDER OPERATING PRESSURES FOR SERIES 9000 VALVES

CYLINDER SIZE	OPERATING PRESSURE psi	
	SERIES 2HS	SERIES 3TH
1-1/2"	2000	5000
2"	2000	5000
2-1/2"	2000	5000
3-1/4"	2000	5000
4"	2000	5000
5"	2000	5000
6"	2000	5000
7"	2000	5000
8"	2000	5000
10"	800	5000
12"	800	5000
14"	800	5000
16"	500	5000
18"	500	5000
20"	500	5000

RED VALVE WARRANTY

WARRANTIES - REMEDIES - DISCLAIMERS - LIMITATION OF LIABILITY
 Unless otherwise agreed to in writing signed by Red Valve, all Products supplied by Red Valve will be described in the specifications set forth on the face hereof.

THE WARRANTIES SET FORTH IN THIS PROVISION ARE EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES WHETHER STATUTORY, EXPRESS OR IMPLIED (INCLUDING ALL WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE AND ALL WARRANTIES ARISING FROM COURSE OF DEALING OR USAGE OR TRADE).

Red Valve Products are guaranteed for a period of one year from date of shipment, against defective workmanship and material only, when properly installed, operated and serviced in accordance with Red Valve's recommendations. Replacement for items of Red Valve's manufacture will be made free of charge if proved to be defective within such year; but not claim for transportation, labor or consequential damages shall be allowed. We shall have the option of requiring the return of the defective product to our factory, with transportation charges prepaid, to establish the claim and our liability shall be limited to the repair or replacement of the defective product, F.O.B. our factory. Red Valve will not assume costs incurred to remove or install defective products nor shall we incur backcharges or liquidated damages as a result of warranty work. Red Valve does not guarantee resistance to corrosion erosion, abrasion or other sources of failure, nor does Red Valve guarantee a minimum length of service, or that the product shall be fit for any particular service. Failure of purchaser to give prompt written notice of any alleged defect under this guarantee forthwith upon its discovery, or use, and possession thereof after an attempt has been made and completed to remedy defects therein, or failure to return product or part for replacement as herein provided, or failure to install and operate said products and parts according to instructions furnished by Red Valve, or failure to pay entire contract price when due, shall be a waiver by purchaser of all rights under these representations. All orders accepted shall be deemed accepted subject to this warranty which shall be exclusive of any other or previous warranty, and shall be the only effective guarantee or warranty binding on Red Valve, anything on the contrary contained in purchaser's order, or represented by any agent or employee of Red Valve in writing or otherwise, notwithstanding implied warranties. RED VALVE MAKES NO WARRANTY THAT THE PRODUCTS, AUXILIARIES AND PARTS ARE MERCHANTABILITY OR FIT FOR ANY PARTICULAR PURPOSE.